



Distribution System Load Forecasting in handling the UI Charges using Neural Network

Dr G Ravikumar

Associate Professor, Department of ECE

Sri Sai Institute of Technology and Science, Rayachoti

Email: ravikumargphd@gmail.com

Abstract—A classical back-propagation neural network is designed for the short term load forecasting along with the expected average frequency of the system in a given unit time-block is tested on the energy consumption of the Southern Power Distribution Company Limited, Andhra Pradesh. The short-term prediction of load (three days in-advance) and scheduling of the load with a time blocks of 15 minutes are to be prepared and submit to the AP Transco. Ltd by all the Distribution Companies of Andhra Pradesh. The scheduling is a major influencing factor to run the Distribution Companies economically profitable. A multilayer network with fourteen inputs and one output with five hidden layers are proposed. This network is tested over a three years of load data with one minute resolution.

Key words: DISCOM, neural network, prediction, ABT

I. INTRODUCTION

In the globalization scenario, with the induction of the liberalization policies and the trend in automation demands the estimation or forecasting of the event. The load forecasting is an essential tool for the intensification of transmission planning and for the future power generation. For smoother operation of the Electrical power system in the deregulated scenario, the coordination is vital between electrical power generating companies, transmission companies, distribution companies and the independent system operator. The economic viable operation and maintenance of Distribution Company is focused in the present work through short term load forecasting which play a vital role in increasing the profits of the Distribution Company. Profitable operation of the Distribution Company depends on the load schedules that are generally submitted by various Distribution Companies well in advance to the independent system operator.

The Peng et.al [1], described using Adaline for ahead a week prediction of load based. The spectral method used for finding the periodicity of loads and categorized the load into high loads and low-loads. The methods described in [1], is not suitable for base-load estimation. Also, the Harmonic nature of load variations presented doesn't occur in practical cases. This is major limitation the work suffers from. It is observed that the weather effect is not properly modeled into the simulation. The approach discussed in [1] is not suitable for the Distribution system short-term load forecasting, because in the deregulated scenario, the time block resolution is fifteen minutes.

Jian-chang Lu et.al [2] work emphasis on the forecasting in real-time using system identification approach on a real-time data with fifteen minutes interval is considered. But, the effect of weather is not focused. Also, the noise characteristic in the data is not clearly defined. The energy consumption variations occur due to load variations and cannot be treated as noise.

Shu Fan, et.al [3] investigated the weather diversity effect over an area on load diversity using support vector machine (SVM). Weather information access in developed countries is easy. However, such facilities in the developing and under developing countries are meek or unobtainable. This approach fails when the weather information is not available. In [3], the weather effect on loads like residential, industrial, agriculture, commercial, etc., are not addressed. The weather influence differs from the one type of load to another.

The energy cost that is purchased by the Distribution companies depends on various factors. However, the influence of power drawl frequency is a major concern in the open-market scenario. The methods described in [1], [2], [3] has not dealt with the influence of grid frequency. In the present work the effect of frequency on the load-patterns is discussed.

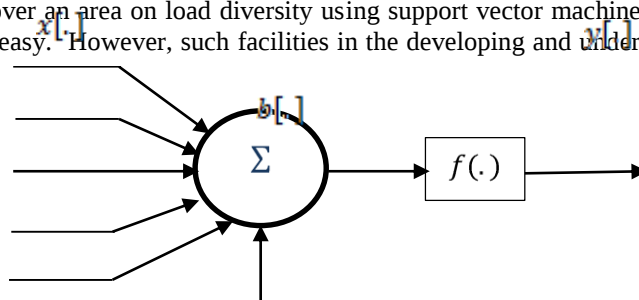


Fig. 1: A single artificial neuron model

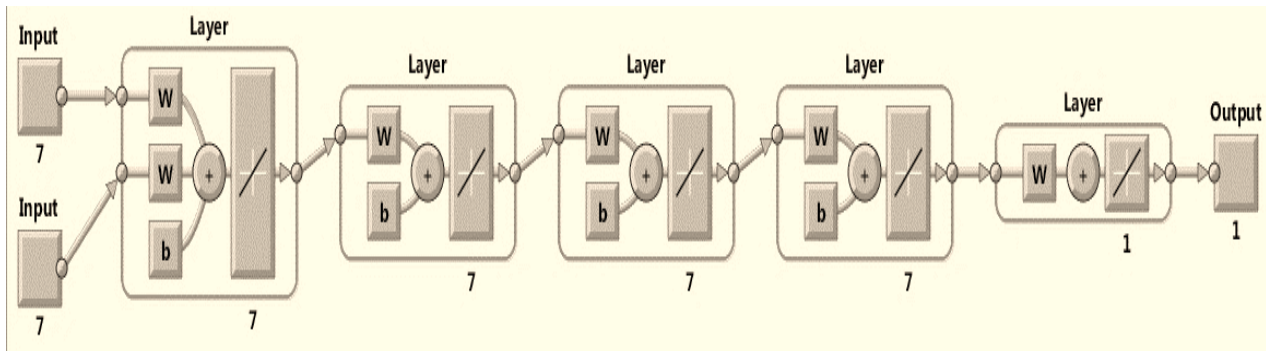


Fig. 2: Custom designed Back Propagation Neural Network (BPNN) model for STLP for SPDCL of A.P.

The work rendered by Takeshi Haida and Shoichi Muto [4] describes a transformation technique in conjunction with the effect of season transition using a transformation technique that converts the temperature data into a function. However, the approach is empirical which doesn't show direct influence or instantaneous influence of the temperature on the electrical energy utilization. Also, the transform approach makes the series stationary and isolate the temporal components of interest [5].

M.Y.Cho, et.al [6] made an attempt, to establish a relationship between ARIMA model and transfer function model in load prediction, using the relationship between the load utilized and the geographical temperature for customers like residential loads, commercial loads, industrial loads, etc., ahead of a week. The derivation of ARIMA model is cumbersome and tedious process to obtain. Also, choosing the optimum correlation order play vital role in the estimation which is a statistical approach. Too many statistical approaches in the model yields more error and requires expertise support.

HuifenNiu, et.al,[7] explained an approach in predicting the water content present in the crude oil.Jianhua Zhang, et.al [8] explained the forecasting of electricity load price with MLP neural network approach through considering the non-Gaussian data series. Yanmei Li [9] explained short term load forecasting using Bayes algorithm and Rough Set (RS) reduction approach that implements MLE algorithm. The objective of the work is based on the non-Gaussian data analysis. It is true that theload patterns are always non-Gaussian because the mean of the power consumption is never zero, hence the data is to be considered as the non-Gaussian only.

In all of the [1], [2], [3], [4], [5], [6], [7] [8] and [9] the authors unable to establish the effect of the UI (unscheduled interface) charges that is a function of the system frequency at which the electrical load is drawn for the utilization by the various distribution companies that are connected to the system.The frequency of the system is dependent on the load drawn and the power injected by the generation companies.

The reforms in electrical power sector are aimed for the accountability of losses, increased responsibility of system running and maintenance for quality service through maintain good voltage profile and frequency of supply. It is known fact that the power drawl frequency has its significant impact on the electrical energy consumption. As the load on the system increases, the frequency on the system (grid) drops and vice-versa. Therefore the system frequency is strategic parameter in the load prediction approaches particularly in the short term load forecasting. Therefore, in the present work an attempt is made to form the relationship between frequency and the load using the artificial neural network assuming that the energy consumption patterns are non-Gaussian.

Also, most of the STLF techniques deal with the hourly data, rather minute by minute data. The present work also includes the prediction of minute by minute analysis because as the data points are more, the error is less. The present approach is quite useful for unit commitment in handling the unscheduled interface (UI) charges, as the UI charges are functional dependent of the frequency as well as the energy drawn from the grid.

II. FORECASTING: A TIME-SERIES APPROACH

The process of estimation of future conditions through a systematic basis is referred as forecasting. In general, the forecasting targets at reducing the uncertainty which influences the decision making by the management with respect to costs, profit, sales, production, distribution, and so forth. One should keep in mind that the prediction is accuracy depend on the assumptions considered for the estimation. Therefore, there must be some error allowable in the forecasting. Any forecasting systems follows the following steps:

1. Observation of past changes.
2. When those changes occurred.
3. Reasons for changes.

Various forecasting techniques/methods are available in literature [10]. However, the extrapolation, regression analysis, time series forecasting are useful methods in the electrical load forecasting.

III. SHORT – TERM LOAD FORECASTING: NEURAL NETWORK APPROACH

The Neural Networks implement recursive algorithms through which the solution is derived from the previous solution as a refined-tuning. Basically, a neural network is a collection of various artificial neurons. The fig. 1 depicts such an artificial neuron. The neural network model provides stronger parallel processing of the data than the existing data processing tools. Moreover, it mimics the human learning process, recognition, estimation, adaption, etc. However, it suffers from sluggish convergent, larger time to train, etc.

The load forecasting is of three types, namely Short-term (a week ahead to less than a month), Medium-term (one month to one year) and long-term (beyond a year). The short-term load forecasting/prediction is quite useful tool to ensure efficient power system operation and control in the modern era which play a crucial for power planning and allocation, etc.

The artificial neural network is a good mathematical tool for complex problems such as data analysis, data feature extraction, prediction/estimation, recognition etc. The artificial neural network simply neural network mimics the neuron functionality of the brain. The fig.2 depicts a typical designed BPNN in Matlab, consisting of two types of inputs, each type takes seven inputs. This network is properly configured with the user data (i.e., the daily energy consumption data of the company and the grid frequency are the two types of the inputs considered in the present NN model).

This BPNN model configuration as described: The neural network consist of five hidden layers which connects the input and output. In contrast the designed BPNN consist of 14 (fourteen) inputs nodes and one output node as shown in the fig. 2. This network is typically a multi-layer perceptron model. Each layer having seven nodes that have the linear activation function expect the fifth hidden layer has only one output which is connected to the output layer. All the nodes are connected through 280 weight elements, with five biases that are connected to each of the summing node.

The supervised learning or training algorithm is used, in which a set of input & output/target data are presented to the designed network. The designed network consist of two input data sets and one output/target data set. (i.e. $x[n]; d[n]$) where each input consists of 7 data points and the target with one sampled point. The output simulated is represented by $y[n]$ for each of the input. Thus the error generated from the desired output and simulated output is given by $e[n]$. This error is given mathematically as:

$$e_k[n] = d_k[n] - y_k[n] \quad (1)$$

where k is the iteration index

The network weights are adjusted in such a way that the error given by eq. (1) is minimized in some sense such as least square, absolute, mean, least mean square, etc. Once, the network is trained it can be put in use for the intended applications such as recognition, prediction, classification, etc.

The selection of the activation function play the key role in simulating the desired output. Many activation functions are available in the literature that may be used a single activation function or combinational functions. However, a single activation function i.e. positive line is used in the current model. The power and/or energy are linear functions of

TABLE I: UNSCHEDULED INTERFACE CHARGES OF THE AP DISCOM FOR VARIOUS FREQUENCY RANGES (U/s Schedule A, clause (1) of Regulation 5)

Below (Upper Limit)	Not Below (Lower Limit)	UI Charges (Paise per KWh)
-----	50.20	0.00
50.20	50.18	16.50
50.18	50.16	33.00
50.16	50.14	49.50
50.14	50.12	66.00
50.12	50.10	82.50
50.10	50.08	99.00
50.08	50.06	115.50
50.06	50.04	132.00
50.04	50.02	148.50
50.02	50.00	165.00
50.00	49.98	193.00
49.98	49.96	222.00
49.96	49.94	250.50
49.94	49.92	279.00
49.92	49.90	307.50
49.90	49.88	336.00
49.88	49.86	364.50
49.86	49.84	393.00
49.84	49.82	421.50
49.82	49.80	450.00
49.80	49.78	478.13
49.78	49.76	506.25
49.76	49.74	534.38
49.74	49.72	562.50
49.72	49.70	590.63
49.70	49.68	618.75
49.68	49.66	646.88
49.66	49.64	675.00
49.64	49.62	703.13
49.62	49.60	731.25
49.60	49.58	759.38
49.58	49.56	787.50
49.56	49.54	815.63
49.54	49.52	843.75
49.52	49.50	871.88
49.50	-----	900.00

frequency in another words as the frequency increases the energy generated is increased. If the frequency (f) is dropped the power (P) utilized increased and vice-versa. But for a grid connected system the frequency rise or drop is a function of the net power. i.e., difference of the actual power generated and actual power consumed. However, the power is a function of frequency and it is related directly proportional to the system frequency. Therefore,

$$P \propto f \quad (2)$$

Where N is the speed of the rotor, in-turn the frequency is the dependent parameter of the speed of the machine. As discussed in [3] and [5], the weather influences the energy consumption to some extent and may not be the same manner by the each of the consumer. However, the reflection on the power consumption can be sensed on the grid frequency in view of equation (2). Therefore, preprocessing of the data may be eliminated so as to make robust analysis.

IV. THE BACK-PROPAGATION TRAINING

The back-propagation algorithm is very popular approach for training the designed neural networks particularly useful in estimation/prediction algorithms. The objective of the training approach is to minimize the error ref. eq. (1) in some sense such as mean absolute, mean square, etc. There are plenty of training algorithms are available algorithms such as Levenberg-Marquadt, Bayesian regularization, BFGS Quasi-Newton back propagation, Resilient back propagation, scaled conjugate gradient search, Powell/Beale conjugate gradient, Fletcher-Powell conjugate gradient, Polak-Ribière Conjugate Gradient, one-step secant, etc., algorithms that finds usefulness in optimize the given criterion. The designed custom neural network is basically a back propagation neural network (BPNN) algorithm, whose performance is measured through mean square error (normalized) during learning/training process. The designed training process is stopped/ceased based on one of the criterions such as the minimum error gradient, maximum learning rate (μ) or maximum number of epochs/iterations. The Levenberg-Marquadt algorithm is the faster supervise algorithm among many training approaches which is used as the present training algorithm. The Bayesian Regularization algorithm is found useful for the training and estimating the frequency of the systems.

V. UN-SCHEDULED INTERFACE (UI) CHARGES

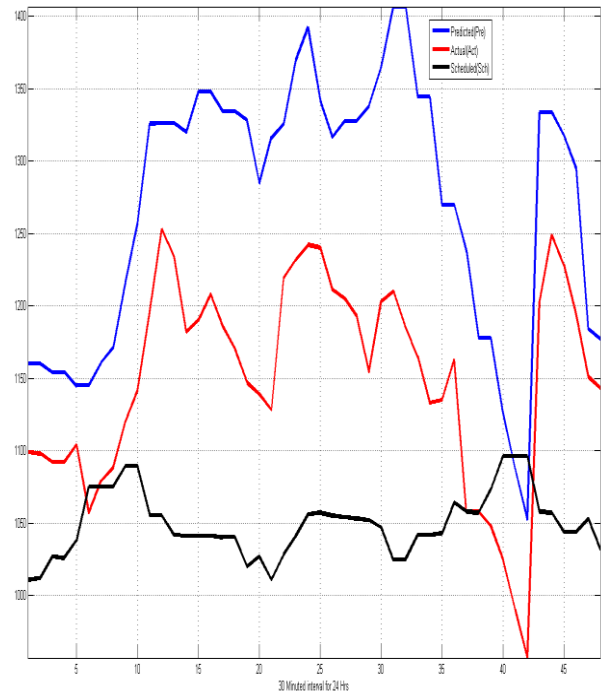


Fig. 3: Comparison of power.

The on-duty LMC staff of the DISCOM prepares & submits the power requirement through their schedules three days ahead based on the available data of the previous day, same day of the previous week, same day of the previous month and the same day of the previous year. According to the quota/based on availability of the power the indented load is allocated for the DISCOMs on the scheduled days for each time-block (each time-block is equal to 15 min). When the utility of the DISCOM less than or equal to the scheduled the DISOM is power tariff is charged as per the agreement. If the utility of DISCOM exceeds than the scheduled load then the DISOM is penalized. This penalty is called the Un-Scheduled Interface (UI) charges. According to the APERC (Andhra Pradesh Electricity Regulatory Commission), the UI charges are shown in the table – I for various frequency ranges that lie in the interval 50.20 – 49.50 Hz. It may be observed that when the DISOM is drawing the energy beyond the 50.20 Hz, for the excess drawl the UI charges is zero. In other words the DISCOM need not pay for the additional drawl as per the schedule. However, the UI charges Therefore the LMC on-duty staff are to be careful during the preparation of their schedules so as to minimize/avoid the UI charges and make the DISCOM profitable. The system frequency forecasting is not considered in the earlier literature. An attempt is also made is estimating the average system frequency so as to minimize the UI charges. An attempt is made through designing a forecasting neural network that uses the wavelet based technique as in [11] for preparing the time-block data. The fig.3 emphasis the predicted power drawl (blue solid line), scheduled power (red solid line) & actual power drawn (black solid line). It is observed that the scheduled power is less than the actual power drawn from the grid and thus deviating from their schedules. This causes to impose UI charges/penalty on the DISCOM. The schedules is shown on 30 min resolution for better understanding through the illustration fig.3. The time block resolution is presently is 30 min, but the policy makers planned to fix the resolution to 15 min instead 30 min. The designed forecasting neural schema is also used for not only the energy forecasting, but also for the predicting the average frequency over a given time block so as to handle the UI charges effectively. The results are validated with the data available in the DISCOM.

The UI charges are soon going to impose on all the DISCOMs of Andhra Pradesh. Accordingly, the DISCOMs have to pay not only for the additional energy drawn but also for the scheduled energy whether the DISCOM is utilized the allocated energy or not in the given unit time block. It is observed that the LMC staff of the DISCOM are preparing the schedules in excess to their requirement irrespective of the allotted unit block quota. Soon, the APERC is inducting its policy through their regulations to charges for the un-utilized energy by the DISCOM according to the scheduled energy.

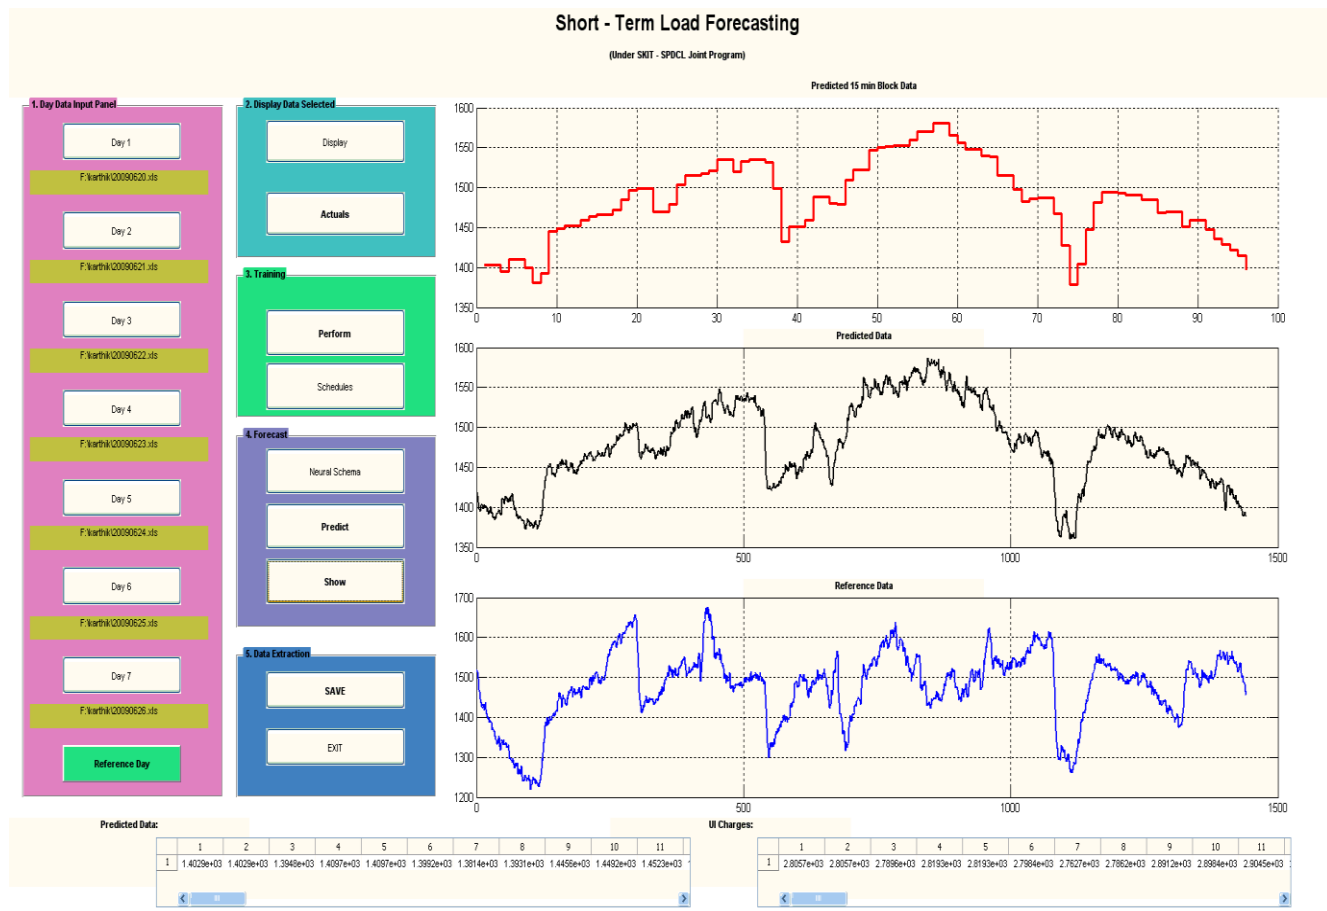


Fig. 4: Application panel (modifiable) developed of Short-Term Load Forecasting.

The present neural schema discussed is quite useful utensil in handling the UI charges so as to minimize the effect of unscheduled energy management.

The panel of the application product developed for SPDCL shown in fig.4 that aids the performance of the on-duty staff in preparing the schedules optimally.

ACKNOWLEDGEMENT

The authors acknowledges to Er. VidyaSagar Reddy, CMD, APSPDCL, for providing the facility at the LMC and data in-order to develop the STLTF software. The authors always remember the support made by P.H.Janaki Ram, D.E (Techn.), O/o CMDPeshi, The authors also express their gratitude to the on-duty staff of SPDCL,Tirupati

REFERENCES

- [1] T.M.Peng, et.al., "An Adaptive Neural Network Work Approach to one-week Ahead Load Forecasting", IEEE Transactions on Power Systems, Vol.8, No.3, pp.1195-1203, August 1993.
- [2] Jian-chang Lu et.al., " A Real-time Adaptive Forecasting Algorithm for Electric Power Load" IEEE/PES Transmission and Distribution Conference & Exhibition: Asia and Pacific, Dalian, Chin.
- [3] Shu Fan, et.al "Multiregion Load Forecasting for System with Large Geographical Area" IEEE Transactions on industry Application, Vol. 45, NO. 4, July/August 2009, pp 1452-1459.
- [4] Takeshi Haida and Shoichi Muto "Regression Based Peal Load Forecasting Using a Transformation Technique", IEEE Transactions on Power Systems, Vol.9 No.4 Nov'1994, pp. 1788-1794.
- [5] Box, G.E.P., et.al "Time Series Analysis: Forecating and Contal" 3rd ed. Upper Saddle River, NJ: Prentice-Hall, 1994.
- [6] M.Y.Cho, et.al " Customer Short Term Load Forecasting by using ARIMA Transfer Function Model" IEEE Catalogue No. 95TH81300-7803-2981 -3/95
- [7] HuifenNiu, et.al, "Application of Wavelet Neural Network to Prediction of Water Content in Crude Oil" Adv. in Neural Network Research &Appli., LNEE 67, pp. 21–27,pringer-Verlag Berlin Heidelberg 2010.
- [8] Jianhua Zhang, et.al "Electricity Price Forecasting Using NeuralNetworksTrained with Entropic Criterion" Adv. in Neural Network Research &Appli., LNEE 67, pp. 47–53, Springer-Verlag Berlin Heidelberg 2010.
- [9] Yanmei Li, "Short-Term Load Forecasting Based on Bayes and RS" Adv. in Neural Network Research &Appli., LNEE 67, pp. 109–116, Springer-Verlag Berlin Heidelberg 2010.
- [10] S.P.Gupta, "Statistical Methods"13th Revised ed. New Delhi, Sultan Chand & Sons, 2001.
- [11] Rajani Kanth V, et.al "DISCOM Load Data Analysis and Grouping: Self Similarity Approach on Non-Fractal Signals", pp. 37-40, J. Innovation in Electronics & Communication, Vol.2 issue2, ISSN: 2249-9946.